

EC Circular Duct Fan

LWDE3G200-IS-03

Ningbo Longwell Electric Technology CO.,LTD

NO.100, Ditang District ,Yuyao,Zhejiang Province,China 315400

Phone 86 574 6218 9863

Fax 86 574 6218 9863

sales@zjlongwell.com

www.longwellfans.com



Model No.:	LWDE3G200-IS-03
Version Number:	A0
Make :	Xia
Review :	Zhong
Approvd :	Jiang
Date:	2024.01.13



Version number	Notes Remarks	Reason content	Revised by	Date

EC Circular Duct Fan

LWDE3G200-IS-03

Nominal Data

Project1	Unit	Rating
Nominal Voltage :	[VAC]	110~240
Voltage Range :	[VAC]	110~240
Frequency :	[Hz]	50/60
Speed :	[rpm]	3000
Rated Current :	[A]	≤1.64
Rated input Power :	[W]	≤180
Air flow (Max) :	[m3/h]	1453
	[CFM]	855
Static pressure (Max) :	[Pa]	721
Noise level (LpA) :	dB(A)	51
Max.ambient Temp :	℃	60
Min.ambient Temp :	℃	-10
Work system :		S1

Technical Features

Production Reference standard	GB12350 《Safety requirements of small power motors》 JB/T10563 《technical specification for general purposes centrifugal fans》 EN60335-1 《Household and similar electrical appliances-safety》 ISO5801-1997 《Industrial fans-performance testing using standardized airways》 GB/T2888 《Methods of Noise Measurement for Fans Blowers Compressors and Roots Blowers》
Certification	CE ETL (UL 507:2017 Ed.10+R:27May2020, CSA C22.2#113:2018 Ed.11)
Environmental protection	RoHS、Reach

EC Circular Duct Fan

LWDE3G200-IS-03

Technical Features

Service environment	Operating temperature: -10~60℃; Operating humidity: 15 ~ 85% RH Storing temperature: -40 ~ 75℃; Storing humidity: 15~85 % RH Applicable altitude range: < 1000m
Life Expectance	50,000Hours(L10), At 25℃ room, humidity 15%~65%RH.
Balancing	According to JB/T 9101-1999 requirements G6.3
Vibration of the fan	Test method accord with JB/T 8689
Material	PP+GF30% (shell) 、 iron (Floor) 、 ABS (impeller) 、 3 cores * 0.75 ² (Lead)
Bearing	Maintenance-free deep groove ball bearings
Weight	3.7KG


Electrical Protection

Speed Control	Out-side speed control box with temperature & humidity function Speed control/Timer/Alarm Function
Insulation Resistance	When test voltage of DC 250v is impressed between terminal(+)and horsing
Dielectric Withstand Voltage	When voltage of AC 500v is Impressed between terminal(+)and housing

EC Circular Duct Fan

LWDE3G200-IS-03


Product Drawing

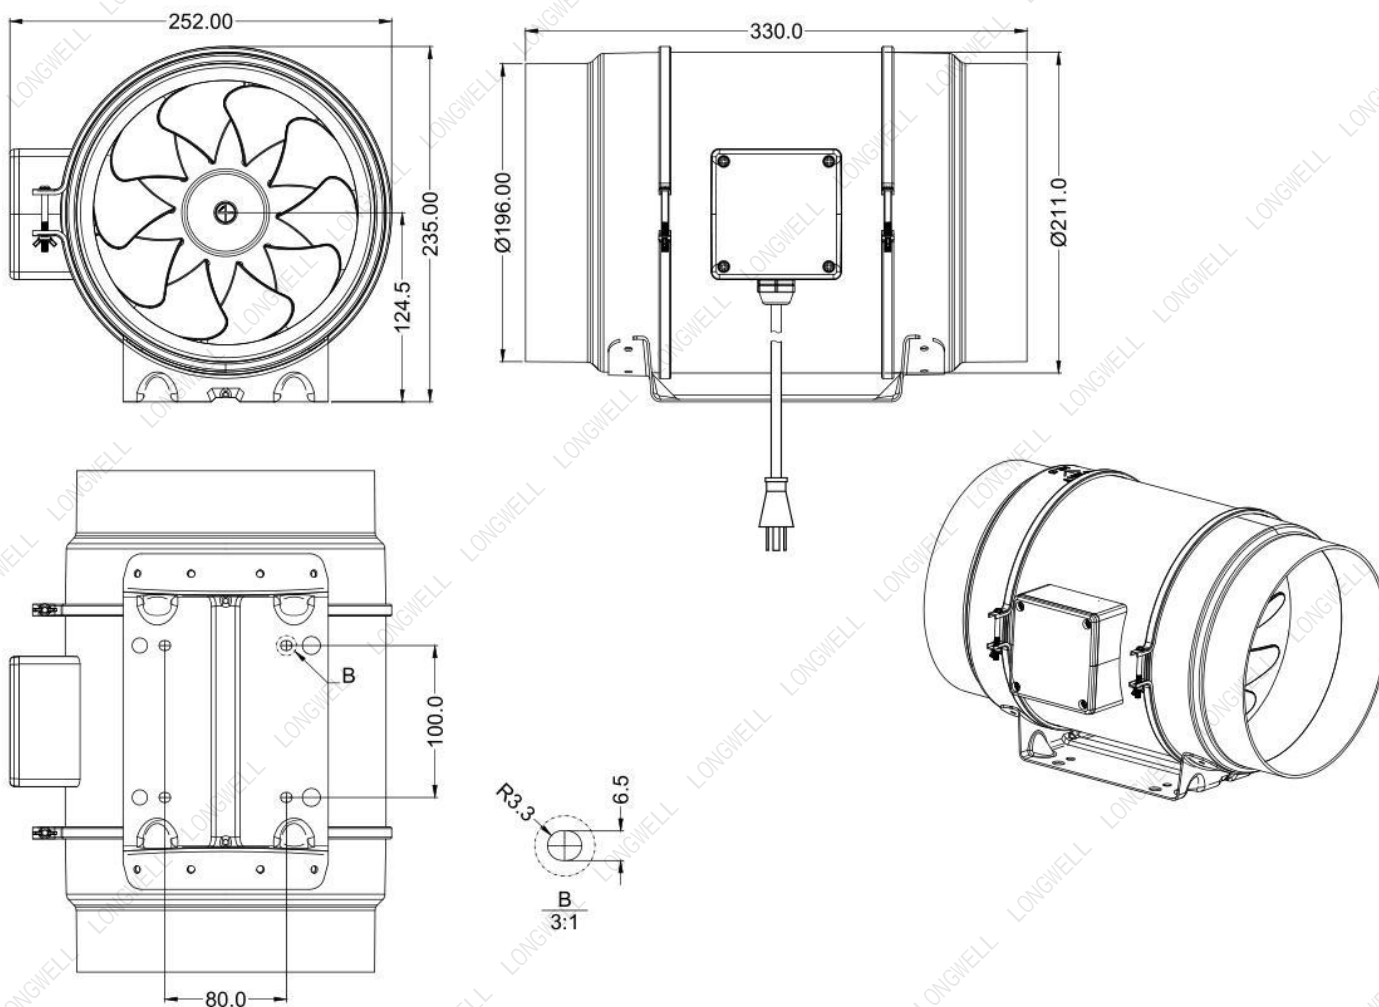

EC Circular Duct Fan

LWDE3G200-IS-03


Exploded diagram

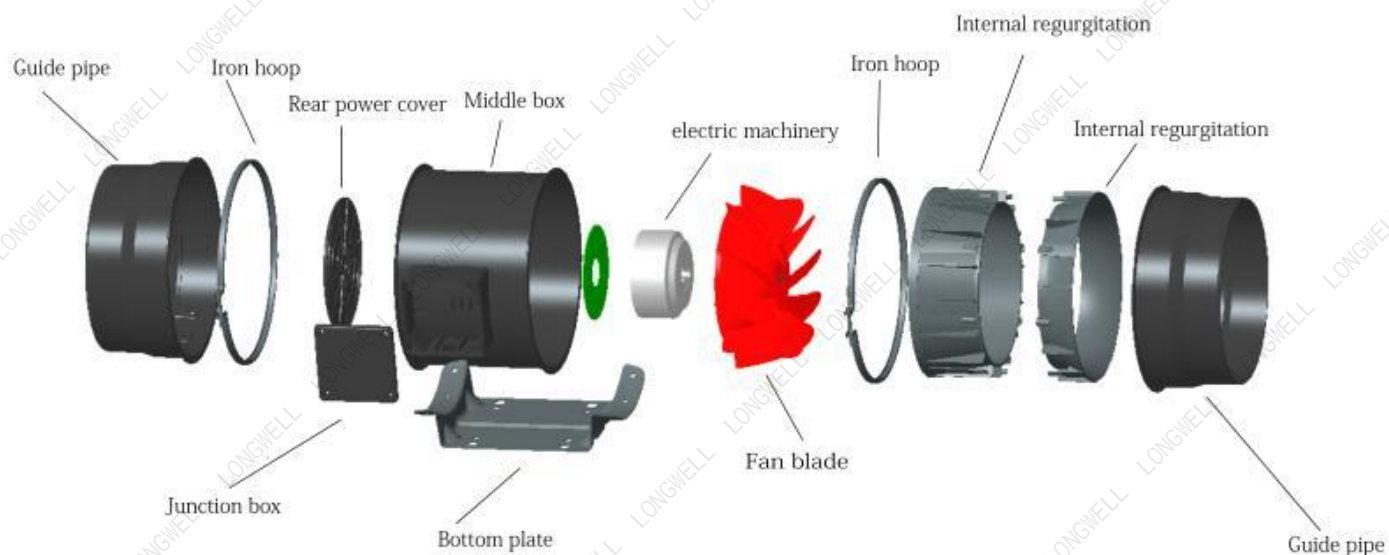

EC Circular Duct Fan

LWDE3G200-IS-03

Charts :Air Flow (P-Q)

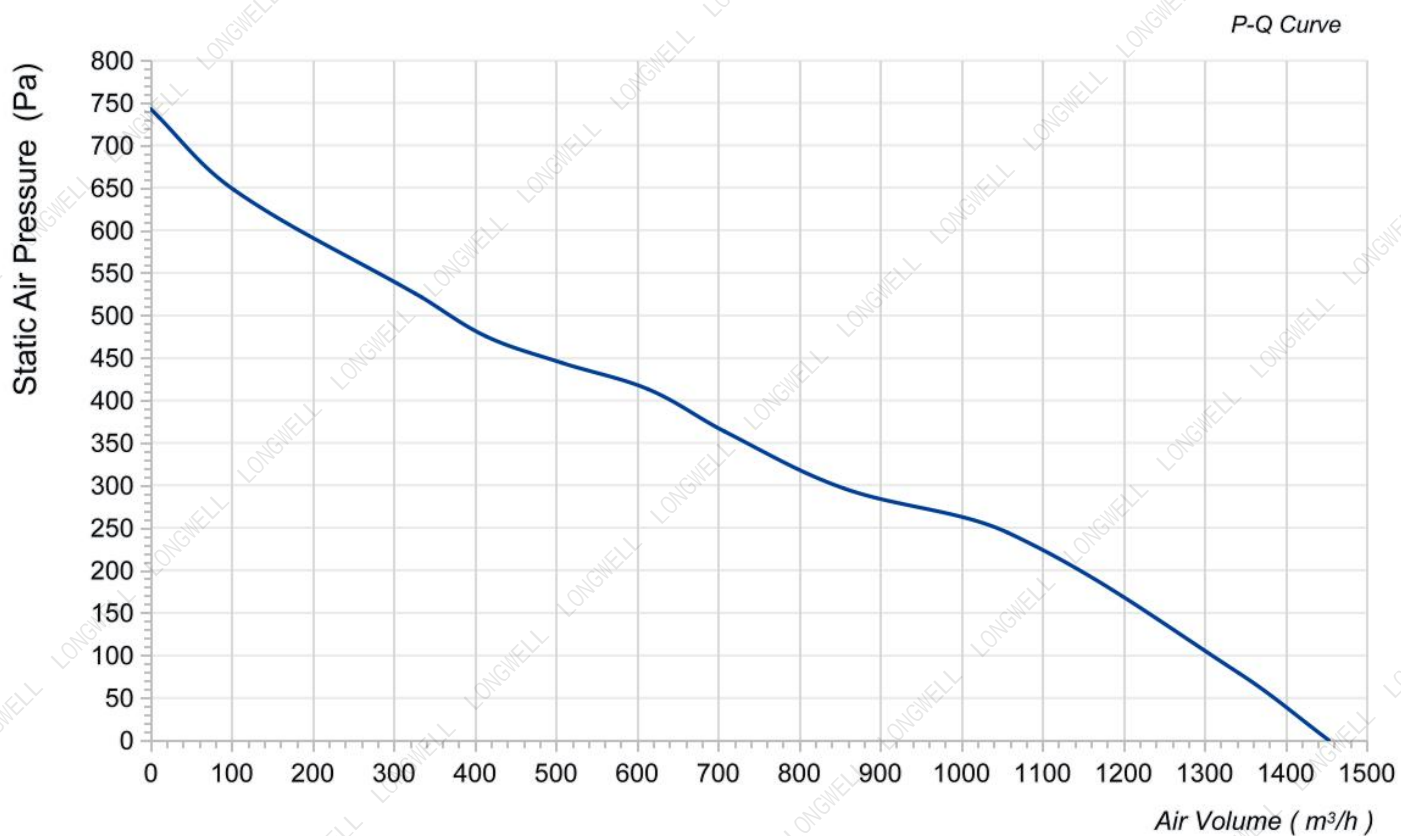

EC Circular Duct Fan**LWDE3G200-IS-03****Warning:**

1. The fan and motor must be used within the prescribed scope of temperature and humidity otherwise it will cause an unexpected damage.
2. Fan is not set wrong connection protection, Provide the right voltage and line sequence according to the nameplate otherwise it will damage the product.
3. Wiring depends on the wiring diagram and please connect the earth ground if required. We don't suggest to use the extension cord .Any wrong connection may cause the damage of the fan.
4. Be careful when moving the fan and do not take the blades as a handle because it will cause the distortion and chatter.
5. Connect the thermostat if required otherwise it would damage the motor because of the over temperature.
6. The length of the mounting screws shall not exceed the requirement, otherwise the fan will be damaged.
7. Do not disassemble the fan arbitrarily. It may hurt the capacity of water tightness and dynamic balance or cause other serious problems.
8. The over current protector is necessary in case the damage from the over current.
9. Install the fan as required, any other installing direction would affect the service life of the product.
10. The fan with inlet ring should be installed follow the requirements or it will affect the performance.
11. Users should use the standard cable when install the fan otherwise it will affect the water tightness.
12. The fan should keep away from the children especially the blade and electric parts .And the children are not allowed to operate the fan alone.
13. Do not connect the white signal cable directly to the red signal cable or the external DC power supply. Otherwise, the fan may be damaged.
14. Please do not perform extraction and insertion of the connector under revolution irrespective of power on and power on and power off , and the fan should not touch or move when running.
15. Do not lift the fan wire when taking the fan, and do not impact the bearing during the handling process.
16. The version change may not be notified, please ask our company for the latest version when necessary.
17. Please be informed that we are not responsible for any damage or accidents caused by violating above rules to install and operate the fan.

EC Circular Duct Fan

LWDE3G200-IS-03

Approval

CUSTOMER APPROVAL**CUSTOMER SIGNATURE:****DATE :****Product Data Confirm :**