

AXIAL FAN - EC Motor

LWAE3G200ST-7PEW-17-00

Ningbo Longwell Electric Technology CO.,LTD

NO.100, Ditang District ,Yuyao,Zhejiang Province,China 315400


Phone 86 574 6218 9863

Fax 86 574 6218 9863

sales@zjlongwell.com

www.longwellfans.com

Model No.:	LWAE3G200ST-7PEW-17-00
Version Number:	A0
Make :	YE
Review :	ZHANG
Approvd :	GUO
Date:	20260806



Version number	Notes Remarks	Reason content	Revised by	Date

AXIAL FAN - EC Motor

LWAE3G200ST-7PEW-17-00

Nominal Data

Project1	Unit	Rating
Nominal Voltage :	[VAC]	230
Voltage Range :	[VAC]	184~270
Frequency :	[Hz]	50/60
Speed :	[rpm]	2650±5%
Current :	[A]	0.6±10%
Power input :	[W]	80±10%
Air flow (Max) :	[m³/h]	1792
	[CFM]	1054
Static pressure (Max) :	[Pa]	233
Noise level :	dB(A)	61±5%
Max.ambient Temp :	℃	60
Min.ambient Temp :	℃	-25
Insulation Class :		Class B
Protection Type :		IP44
Work system :		S1

Technical Features

Production Reference standard	GB12350 《Safety requirements of small power motors》 JB/T10562 《 Technical specification for general purposes axial fans》 EN60335-1 《Household and similar electrical appliances-safety》 ISO5801-1997 《Industrial fans-performance testing using standardized airways》 GB/T2888 《Methods of Noise Measurement for Fans Blowers Compressors and Roots Blowers》
Certification	CE
Environmental protection	RoHS、 Reach

AXIAL FAN - EC Motor

LWAE3G200ST-7PEW-17-00

Technical Features

Service environment	Operating temperature: -25~60℃; Operating humidity: 5 ~ 95 % RH Storing temperature: -40 ~ 75℃; Storing humidity: 5 ~ 95 % RH Applicable altitude range: < 1000m
Life Expectance	50,000Hours(L10), At 40℃ room, humidity 15%~65%RH.
Balancing	According to JB/T 9101-1999 requirements G6.3
Vibration of the fan	Test method accord with JB/T 8689
Installation method	Horizontal or vertical installation
Material	Galvanized steel sheet (Impeller)
Bearing	Maintenance-free deep groove ball bearings
Weight	/


Electrical Protection

Speed Control	Control input 0~10VDC/PWM
VSP Control	Control signal VSP voltage range $1.1 \pm 0.1\text{VDC} \sim 9.75 \pm 0.25\text{VDC}$ (During normal operation, when the VSP voltage is below 1.0VDC, the motor switches from operating mode to standby mode)
PWM Control	PWM signal: frequency 1K ~ 10KHz, amplitude 10 ~ 12V, duty cycle 30% ~ 70% .
Signal Output	Tach output: 4 Pulse/R; FG internal open circuit output, external pull-up resistor R, pull-up voltage V+
Auxiliary power output	Output 10VDC, Max Current 10mA
Protection	Current limiting protection 、 Over-temperature protection、 Over-current protection Locked-rotor protection
Soft start	Delay time <20 seconds to full speed
Serial Communication	/

AXIAL FAN - EC Motor

LWAE3G200ST-7PEW-17-00

Product Drawing

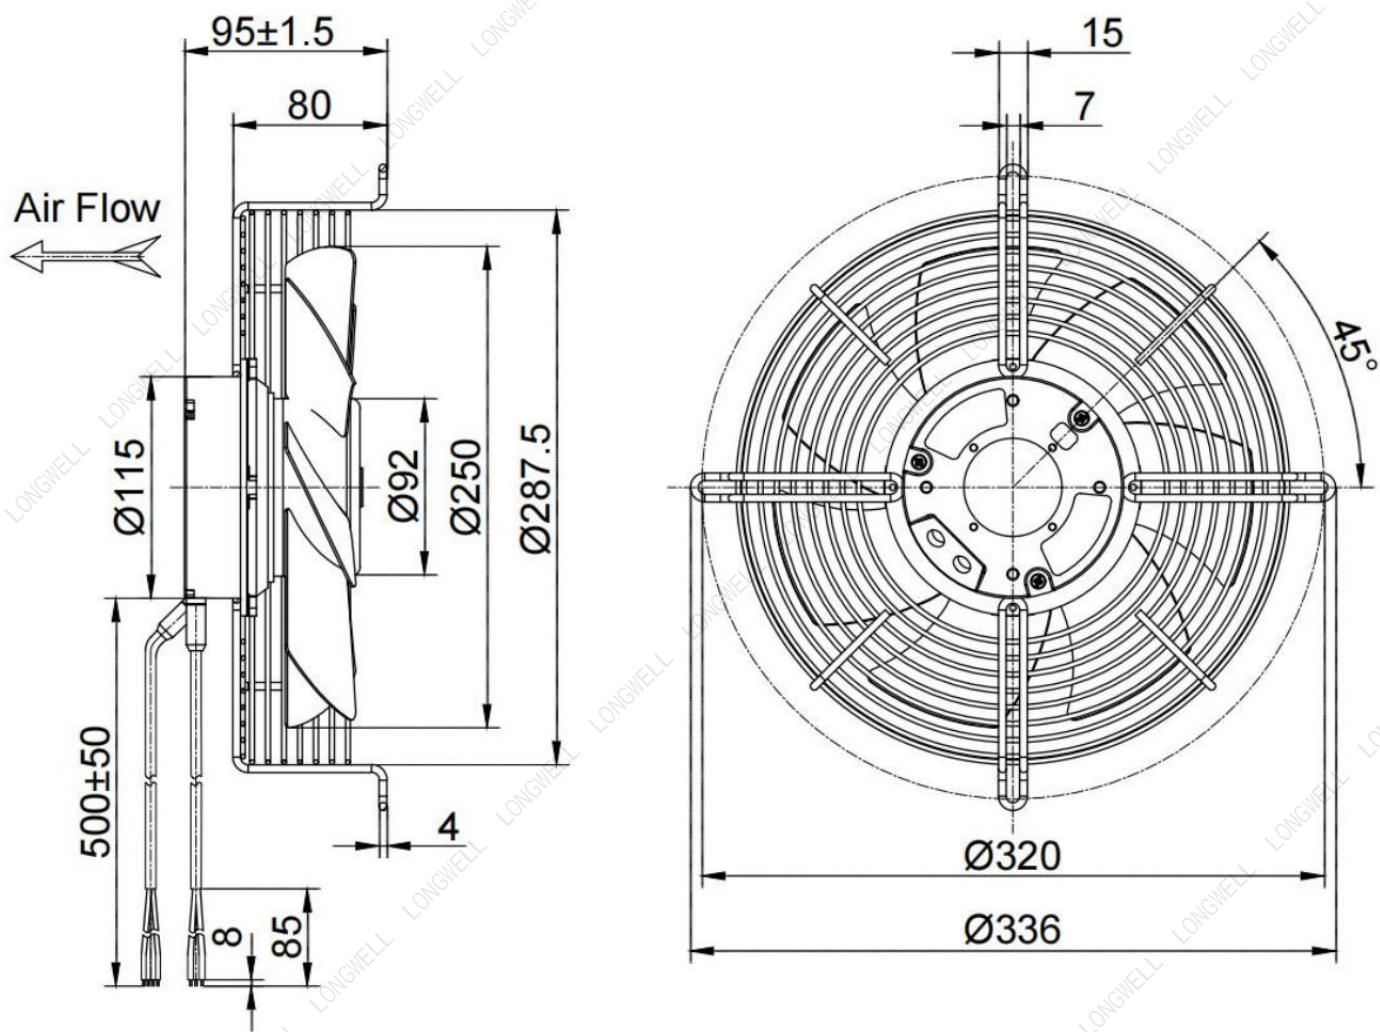

AXIAL FAN - EC Motor

LWAE3G200ST-7PEW-17-00

Wiring Diagram

L	Color	Function	Functional description
L1	Brown	L	Power supply Line conductor,50/60Hz
	Blue	N	Power supply,neutral conductor,50/60 Hz
	Yellow/Green	PE	Protective earth
L2	Red	+10VDC	Voltage output +10VDC max.1.1mA
	Blue	GND	GND connection of control interface
	Yellow	Speed Control	Control input 0~10VDC or PWM
	White	FG	Tach output:4 pulse per revolution

Label


Confirm by sales team when placing sample order or bulk order

AXIAL FAN - EC Motor

LWAE3G200ST-7PEW-17-00

Charts :Air Flow (P-Q)

P-Q Curve

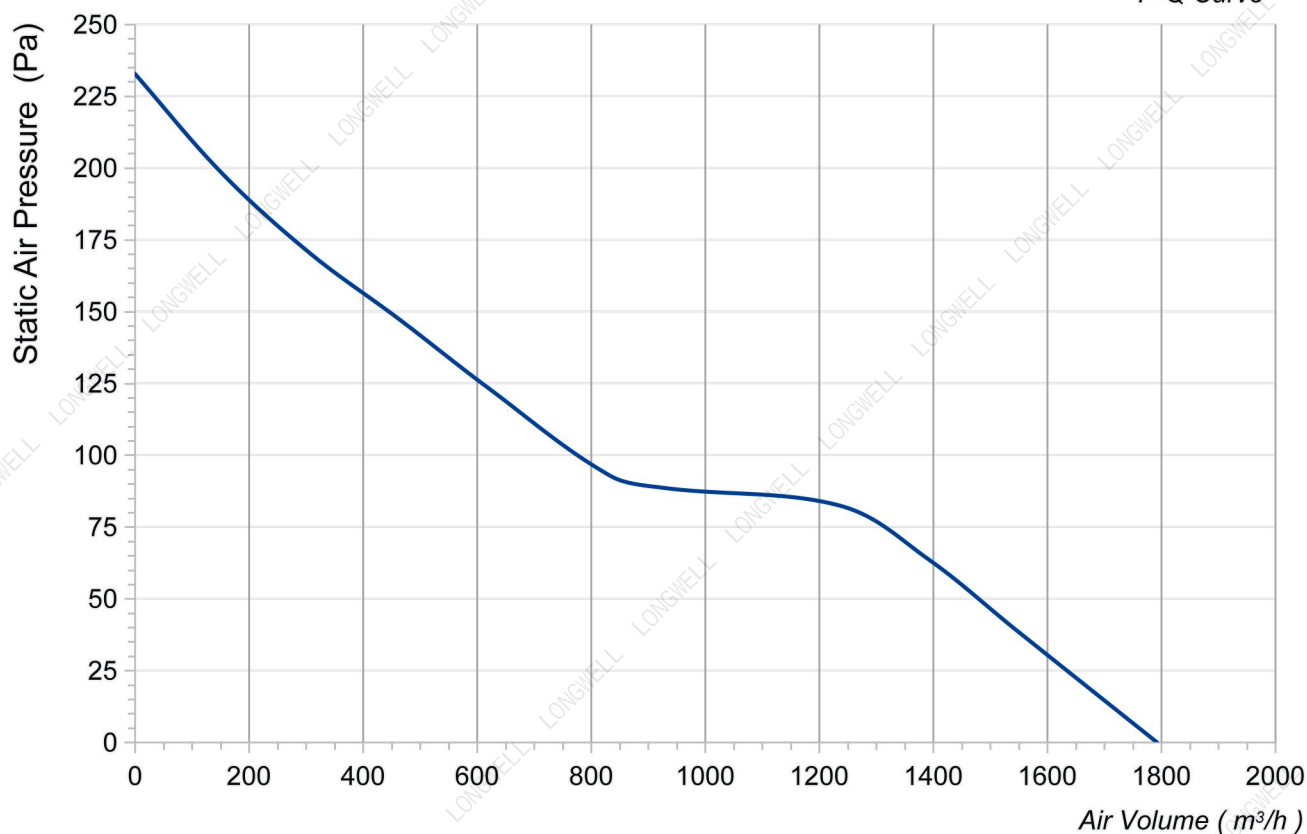

AXIAL FAN - EC Motor**LWAE3G200ST-7PEW-17-00****Warning:**

1. The fan and motor must be used within the prescribed scope of temperature and humidity otherwise it will cause an unexpected damage.
2. Fan is not set wrong connection protection, Provide the right voltage and line sequence according to the nameplate otherwise it will damage the product.
3. Wiring depends on the wiring diagram and please connect the earth ground if required. We don't suggest to use the extension cord .Any wrong connection may cause the damage of the fan.
4. Be careful when moving the fan and do not take the blades as a handle because it will cause the distortion and chatter.
5. Connect the thermostat if required otherwise it would damage the motor because of the over temperature.
6. The length of the mounting screws shall not exceed the requirement, otherwise the fan will be damaged.
7. Do not disassemble the fan arbitrarily. It may hurt the capacity of water tightness and dynamic balance or cause other serious problems.
8. The over current protector is necessary in case the damage from the over current.
9. Install the fan as required, any other installing direction would affect the service life of the product.
10. The fan with inlet ring should be installed follow the requirements or it will affect the performance.
11. Users should use the standard cable when install the fan otherwise it will affect the water tightness.
12. The fan should keep away from the children especially the blade and electric parts .And the children are not allowed to operate the fan alone.
13. Do not connect the white signal cable directly to the red signal cable or the external DC power supply. Otherwise, the fan may be damaged.
14. Please do not perform extraction and insertion of the connector under revolution irrespective of power on and power on and power off , and the fan should not touch or move when running.
15. Do not lift the fan wire when taking the fan, and do not impact the bearing during the handling process.
16. The version change may not be notified, please ask our company for the latest version when necessary.
17. Please be informed that we are not responsible for any damage or accidents caused by violating above rules to install and operate the fan.

AXIAL FAN - EC Motor

LWAE3G200ST-7PEW-17-00

Approval

CUSTOMER APPROVAL**CUSTOMER SIGNATURE:****DATE :****Product Data Confirm :****Speed Control System :**☐

PWM

☐

0-10V

Note :Please check and mark the data when you sign the specification sheet .